




PNEUMATIC CONTROL
FAN POWERED TERMINAL UNIT • PARALLEL FLOW
VARIABLE VOLUME • PRESSURE INDEPENDENT
MODEL: 35NE 2P3

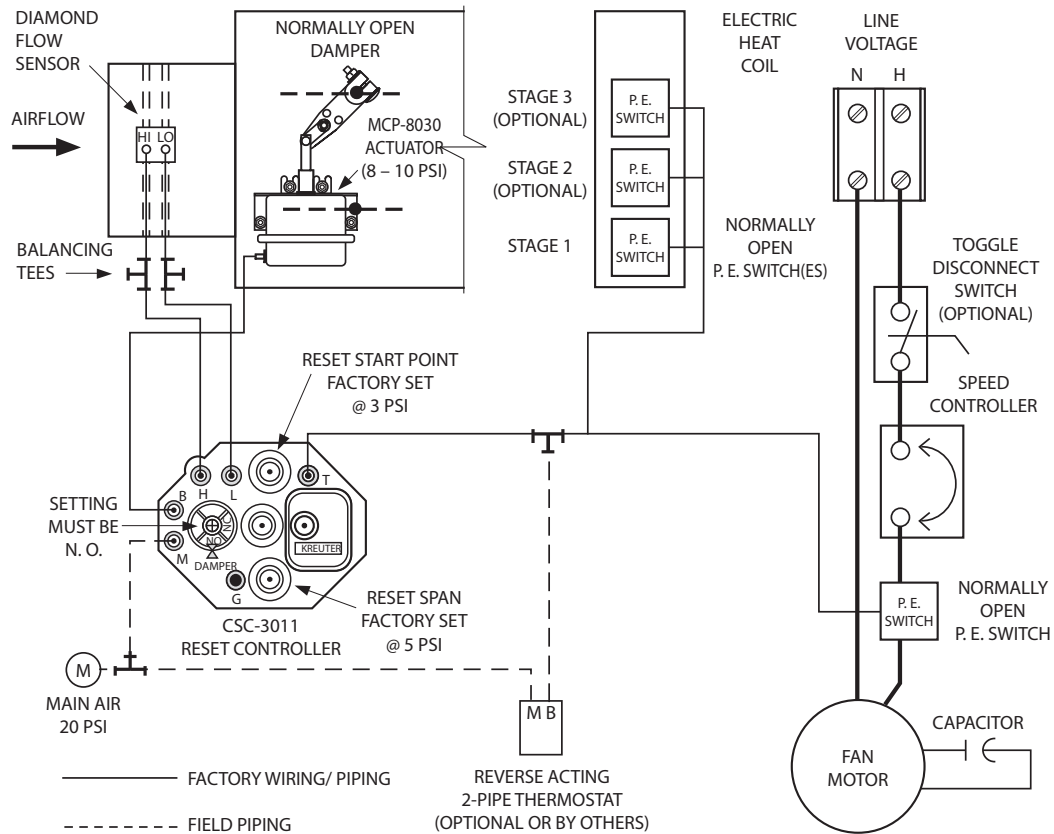

CONTROL SEQUENCE 2P3 • VAV COOLING WITH ELECTRIC HEAT • REVERSE ACTING/NORMALLY OPEN (RA/NO) • 3000 CONTROLLER

Sequence of Operation:

On a rise in space temperature, the thermostat regulates the controller to increase primary airflow.

When the space temperature is warm, the primary air damper is controlling at the maximum airflow setting.


As the space temperature decreases, the damper modulates back towards the minimum airflow setting. If room temperature continues to drop, the fan is energized and warm air is induced from the ceiling plenum. Minimum primary airflow is maintained and staged electric heat is energized.

Primary airflow is held constant in accordance with thermostat demand. Any changes in volume due to static pressure fluctuations are sensed and compensated for, resulting in pressure independent control.

Options:

Two Pipe Thermostat (Vertical Mount. Includes backing plate for 2" x 4" electrical box).

- CTC-1622-103 °F scale plate
- CTC-1622-113 °C scale plate

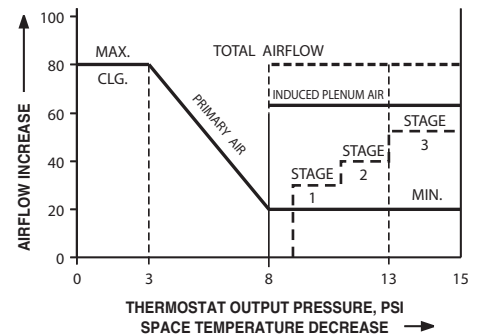

SCHEDULE TYPE:				
PROJECT:				
ENGINEER:				
CONTRACTOR:				
DATE	B SERIES	SUPERSEDES	DRAWING NO.	
12 - 09 - 13	3500	NEW	35NECD-2P3	