

# UNDERFLOOR FAN BOOSTER UNIT WITH ECM MOTOR

VARIABLE OR CONSTANT VOLUME

MODELS: 38F, 38FW AND 38FE • UNIT SIZE 33


#### **STANDARD FEATURES:**

- 20 ga. (1.0) galvanized steel casing components.
- · Dual fan operation on cooling.
- Single fan operation on heating. Backdraft damper on slave cooling unit inlet prevents back flow during heating.
- · Full size top access panel.
- Access door for side access to damper actuators.
- Return inlet and discharge openings designed for flanged duct connection.
- 1/2" (13) dual density insulation, exposed edges coated to prevent air erosion. Meets requirements to NFPA 90A and UL181.
- Ultra-high efficiency ECM fan motor. EPIC fan volume controller.
- Motor blower assembly mounted on special 16 ga. (1.6) angles and isolated from casing with rubber isolators.
- · Single point electrical connection.
- Top access hinged door on the line voltage/fan controls enclosure.
- Controls mounted as standard on RH side as shown. (Terminals ordered with LH controls are optional. See submittal drawing 38F-33LH).

#### **OPTIONS:**

- ☐ Toggle disconnect switch.
- ☐ Fiber-free liner.
- ☐ Perforated metal liner.
- ☐ Steri-liner.
- Isolator pads.
- ☐ Fan Unit fusing.
- ☐ Left hand controls location.
- ☐ Discharge collars. Flat oval transitions for flexible duct connection. 12" (14 1/4" x 7 3/4").
- Special features:

### ☐ Model 38F Basic Unit

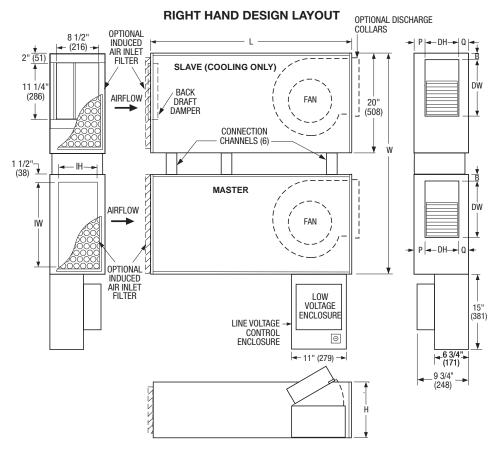

## **Dimensional Data. Imperial Units (inches)**


Unit Size	w	Н	L	В	Р	Q	Inlet IW x IH	Outlet Discharge DW x DH	Filter Size
33	44 1/2	11	40	1 3/8	2	2	17 x 8	11 1/4 x 7	19 x 10 (2)

## **Dimensional Data. Metric Units (mm)**

Unit Size	W	Н	L	В	P	Q	Inlet IW x IH	Outlet Discharge DW x DH	Filter Size
33	1130	279	1016	35	51	51	432 x 203	286 x 178	483 x 254(2)

#### **Electrical Data**

1	Motor								
Size	H.P.	Voltage	120/1/60	208/240/1/60	277/1/60				
33	2@1/3	Watts	840	900	820				
33		FLA	11.6	6.81	5.8				





SCHEDULE TYPE:	Page 1 of 3  Dimensions are in inches (mm).			
PROJECT:	Dir	nensions are	in inches (m	im).
ENGINEER:	DATE	B SERIES	SUPERSEDES	DRAWING NO.
CONTRACTOR:	8 - 20 - 08	38F	8 - 13 - 07	38F-33RH



# UNDERFLOOR FAN BOOSTER UNIT WITH ECM MOTOR

VARIABLE OR CONSTANT VOLUME • HOT WATER HEAT **MODEL**: 38FW • UNIT SIZE 33

# ☐ Hot Water Coil Section Model 38FW

# **Standard Features:**

- Coil section installed on master unit discharge.
- Coil (and header on multi-circuit units) is installed in insulated casing for increased thermal efficiency.
- 1/2" (13) copper tubes.
- · Aluminum ripple fins.
- Sweat connections: One Row 1/2" (13)
   O.D. male solder. Two and three row 7/8"
   (22) O.D. male solder.
- Full size top access panels for inspection and coil cleaning.
- · Flanged outlet duct connection.

### Coil Rows:

☐ 1-Row ☐ 2-Row ☐ 3-Row

### **Coil Connections:**


(Looking in direction of airflow).

☐ Right hand (illustrated). Standard. (Terminal ordered with LH coil connections are optional. See submittal drawing 33F-33LH).

#### **OPTIONS:**

- ☐ Discharge collars. Flat oval transitions for flexible duct connection. 12" (14 1/4" x 7 3/4").
- ☐ Special features: \_\_\_\_\_



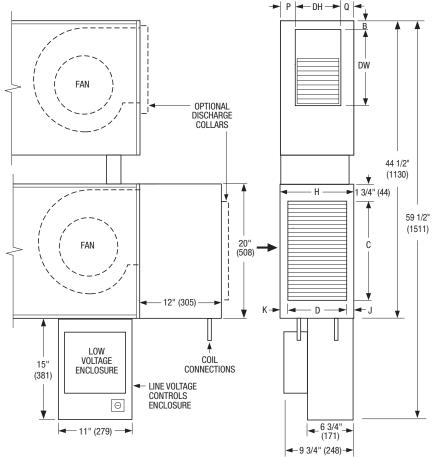

# **Dimensional Data. Imperial Units (inches)**

Unit Size	Н	В	Р	Q	J	к	Outlet Discharge C x D	Outlet Discharge DW x DH
33	11	1 3/8	2	2	1	1 3/4	14 3/4 x 8 3/4	11 1/4 x 7

## **Dimensional Data. Metric Units (mm)**

Unit Size	Н	В	Р	Q	J	К	Outlet Discharge C x D	Outlet Discharge DW x DH
33	279	35	51	51	29	29	375 x 222	286 x 178



AAUEDUU E EVE	Page 2 of 3				
SCHEDULE TYPE:	Dir	nensions are	in inches (m	ım)	
PROJECT:	Dimensions are in inches (mm).  DATE B SERIES SUPERSEDES DRAWING  8 - 20 - 08 38E 8 - 13 - 07 38E-33E				
ENGINEER:	DATE	B SERIES	SUPERSEDES	DRAWING NO.	
CONTRACTOR:	8 - 20 - 08	38F	8 - 13 - 07	38F-33RH	



# UNDERFLOOR FAN BOOSTER UNIT WITH ECM MOTOR

VARIABLE OR CONSTANT VOLUME • ELECTRIC HEAT **MODEL**: 38FE • UNIT SIZE 33

# ☐ Electric Coil Section Model 38FE

### **Standard Features:**

- · Coil installed on master unit discharge.
- · Insulated heater element wrapper.
- Automatic reset high limit cut-outs (one per element).
- · Flanged outlet duct connection.
- · Airflow safety switch to prove airflow.
- Single Point electrical connection for entire terminal unit.
- Terminal unit with heater is ETL listed as an assembly.
- Controls mounted as standard on RH side as shown (Terminal ordered with LH controls are optional. See submittal drawing 38F-33LH).

Voltage:	ae:
----------	-----

Singl	e phase	, 60	HZ

□ 208V □ 240V □ 277V

Three phase, 60 Hz.


□ 208V □ 480V (4 wire wye).

\_ .\_\_

### **Options:**

- ☐ Toggle disconnect switch.
- ☐ Door interlock disconnect switch.
- Mercury contactors.
- Power circuit fusing.
- ☐ Class 'A' 80/20 Ni./Cr. Wire.
- ☐ Dust tight construction.
- ☐ Manual reset secondary thermal cut out.
- ☐ Discharge collars. Flat oval transitions for flexible duct connection. 12" (14 1/4" x 7
- ☐ Special features:

## RIGHT HAND DESIGN LAYOUT

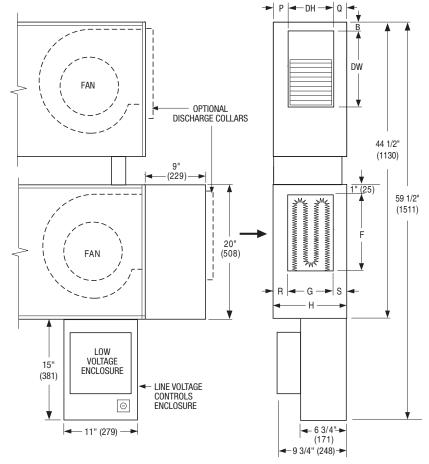

# **Dimensional Data. Imperial Units (inches)**

Unit Size	Н	В	Р	ď	R	S	Outlet Discharge F x G	Outlet Discharge DW x DH
33	11	1 3/8	2	2	1 5/8	1 5/8	11 x 7 3/4	11 1/4 x 7

## **Dimensional Data. Metric Units (mm)**

Unit Size	Н	В	Р	q	R	S	Outlet Discharge F x G	Outlet Discharge DW x DH
33	279	35	51	51	41	41	279 x 197	286 x 178



SCHEDULE TYPE:	Page 3 of 3  Dimensions are in inches (mm).			
PROJECT:	. ,			im).
ENGINEER:	DATE	B SERIES	SUPERSEDES	DRAWING NO.
CONTRACTOR:	8 - 20 - 08	38F	8 - 13 - 07	38F-33RH