

UNDERFLOOR FAN BOOSTER UNIT WITH ECM MOTOR • COOLING AND HEATING DAMPERS • VARIABLE OR CONSTANT VOLUME MODELS: 38F, 38FW AND 38FE • UNIT SIZE 6

STANDARD FEATURES:


- 20 ga. (1.0) galvanized steel casing components.
- Unit incorporates three low leakage dampers for 2 position open/closed operation. Two are used for supply air cooling mode (from underfloor plenum) and the other for return air heating mode airflow (ducted).
- · Full size top access panel.
- Enclosures for damper actuators.
- Retangular return heating inlet damper sleeve for ducted connection.
- Discharge opening designed for flanged duct connection.
- 1/2" (13) dual density insulation, exposed edges coated to prevent air erosion. Meets requirements to NFPA 90A and UL181.
- Ultra-high efficiency ECM fan motor. EPIC fan volume controller.
- Motor blower assembly mounted on special 16 ga. (1.6) angles and isolated from casing with rubber isolators.
- · Single point electrical connection.
- Top access hinged door on the line voltage/fan controls enclosure.
- Controls mounted as standard on RH side as shown. (LH controls location is optional).

OPTIONS:

- ☐ Toggle disconnect switch.
- ☐ Fiber-free liner.
- ☐ Perforated metal liner.
- ☐ Steri-liner.
- Isolator pads.
- ☐ Fan Unit fusing.
- ☐ Left hand controls location.
- ☐ Heating damper collar. Flat oval transition on return air inlet for flexible duct connection. 10" (11 1/8" x 7 3/4") or 12" (14 1/4" x 7 3/4").
- ☐ Discharge collar. Flat oval transition for flexible duct connection. 14" (17 3/8" x 7 3/4").
- ☐ Special features: _

☐ Model 38F Basic Unit

RIGHT HAND CONTROLS LOCATION

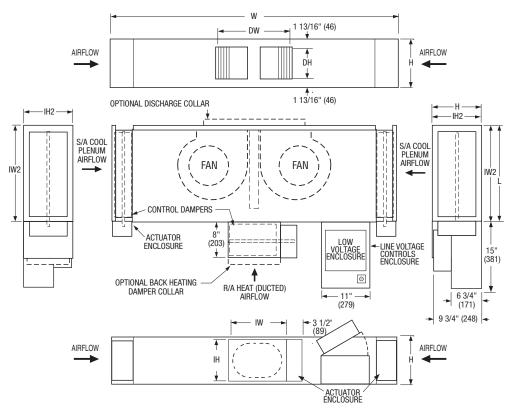

Dimensional Data. Imperial Units (inches)

Unit Size	· \//	Н	L	Heating Inlet IW x IH	W x IH IW2 x IH2	
6	64	10 1/2	21	15 3/4 x 9 5/8	20 1/2 x 10	16 1/2 x 6 7/8

Dimensional Data. Metric Units (mm)

Unit Size	w	н	L	Heating Inlet IW x IH	Cooling Inlets (2) IW2 x IH2	Outlet Discharge DW x DH
6	1626	267	533	400 X 244	521 X 254	419 X 175

Electrical Data

Unit	Motor	ECM Motor					
Size	H. P.	Voltage	120/1/60	208/240/1/60	277/1/60		
6	2@1/3	Watts	840	840	890		
0	2@1/3	FLA	10.2	5.3	5.9		




FLA = Full load amperage

SCHEDULE TYPE:	Page 1 of 3 Dimensions are in inches (mm).			
PROJECT:				ım).
ENGINEER:	DATE	B SERIES	SUPERSEDES	DRAWING NO.
CONTRACTOR:	8 - 20 - 08	38F	3 - 3 - 08	38F-6DRH



UNDERFLOOR FAN BOOSTER UNIT WITH ECM MOTOR • COOLING & HEATING DAMPERS VARIABLE OR CONSTANT VOLUME • HOT WATER HEAT MODEL: 38FW • UNIT SIZE 6

RIGHT HAND CONTROLS LOCATION

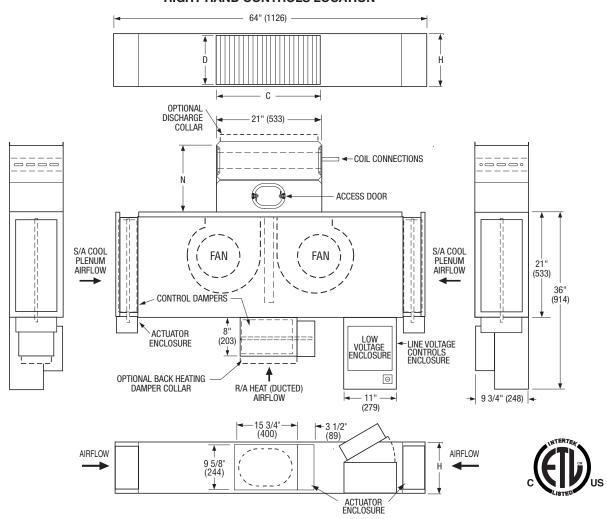

☐ Hot Water Coil Section Model 38FW Standard Features:

- Coil section installed on unit discharge.
- 1/2" (13) copper tubes.
- · Aluminum ripple fins.
- Sweat connections: One Row 1/2" (13) O.D. male solder. Two and three row 7/8" (22) O.D. male solder.
- · Top access door for inspection and coil cleaning.
- · Slip and drive discharge duct connection.

Coil Rows:

☐ 1-Row ☐ 2-Row ☐ 3-Row

Coil Connections:

(Looking in direction of airflow).

- ☐ Right hand (illustrated). Standard.
- ☐ Left hand. Optional.

	Imperial Un	Metric Units (mm)				
Unit Size	Outlet Discharge C x D	Н	N	Outlet Discharge C x D	Н	N
6	21 x 10	10 1/2	14 1/2	533 X 254	267	368

Options:

- ☐ Heating damper collar. Flat oval transition on return air inlet for flexible duct connection. 10" (11 1/8" x 7 3/4") or 12" (14 1/4" x 7 3/4").
- ☐ Discharge collar. Flat oval transition for flexible duct connection. 14" (17 3/8" x 7 3/4").
- □ Special features: _____.

Page 2 of 3


SCHEDULE TYPE:	Dimensions are in inches (mm).			
PROJECT:	Dimensions are in mones (min).			
ENGINEER:	DATE	B SERIES	SUPERSEDES	DRAWING NO.
CONTRACTOR:	8 - 20 - 08	38F	5 - 3 - 08	38F-6DRH



UNDERFLOOR FAN BOOSTER UNIT WITH ECM MOTOR • COOLING & HEATING DAMPERS VARIABLE OR CONSTANT VOLUME • ELECTRIC HEAT MODEL: 38FE • UNIT SIZE 6

☐ Electric Coil Section Model 38FE

RIGHT HAND CONTROLS LOCATION

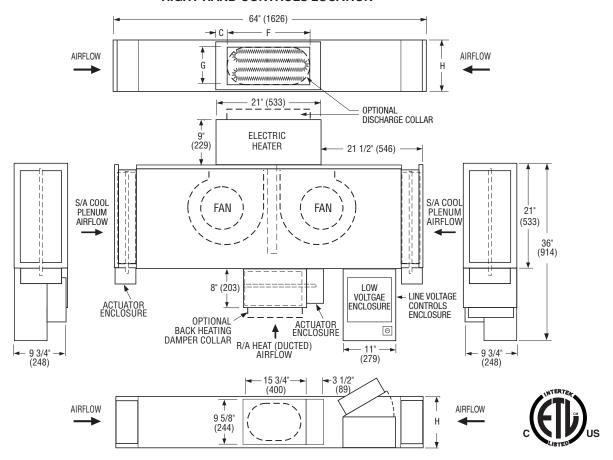

Standard Features:

Mercury contactors.

- · Coil installed on unit discharge.
- · Insulated heater element wrapper.
- Automatic reset high limit cut-outs (one per element).
- · Flanged outlet duct connection.
- Airflow safety switch to prove airflow.
- Single point electrical connection for entire terminal unit.
- Terminal unit with heater is ETL listed as an assembly.
- Controls mounted as standard on RH side as shown.

Voltage:

Single phase, 60 Hz. □ 208V □ 240V □ 277V

Three phase, 60 Hz.
□ 208V □ 480V (4 wire wye). □ _____

Options:
□ Toggle disconnect switch.
□ Door interlock disconnect switch.

	Imperial Un	its (incl	Metric Units (mm)			
Unit Size	Outlet Discharge F x G	н	С	Outlet Discharge F x G	н	С
6	17 5/8 x 7 1/4	10 1/2	1 11/16	448 X 184	267	41

- Power circuit fusing.
- ☐ Class 'A' 80/20 Ni./Cr. Wire.
- ☐ Dust tight construction.
- ☐ Manual reset secondary thermal cut out.
- ☐ Heating damper collar. Flat oval transition on return air inlet for flexible duct connection. 10" (11 1/8" x 7 3/4") or 12" (14 1/4" x 7 3/4").
- ☐ Discharge collar. Flat oval transition for flexible duct connection. 14" (17 3/8" x 7 3/4").
- ☐ Special features: ______.

Page 3 of 3.

 SCHEDULE TYPE:
 Dimensions are in inches (mm).

 PROJECT:
 DATE
 B SERIES
 SUPERSEDES
 DRAWING NO.

 CONTRACTOR:
 8 - 20 - 08
 38F
 5 - 3 - 08
 38F-6DRH