




**Nailor®**  
Industries Inc.

**HEPA FILTERS  
FOR HOSPITAL/CLEANROOM DIFFUSERS  
IMPERIAL MODULES  
MODEL: 92GSF-HE**

DIFFUSER KNIFE EDGE  
DIMENSION = NOMINAL  
SIZE - 5 3/8" (137)

CENTERBOARD  
WITH PORT  
FOR DAMPER  
CONTROL

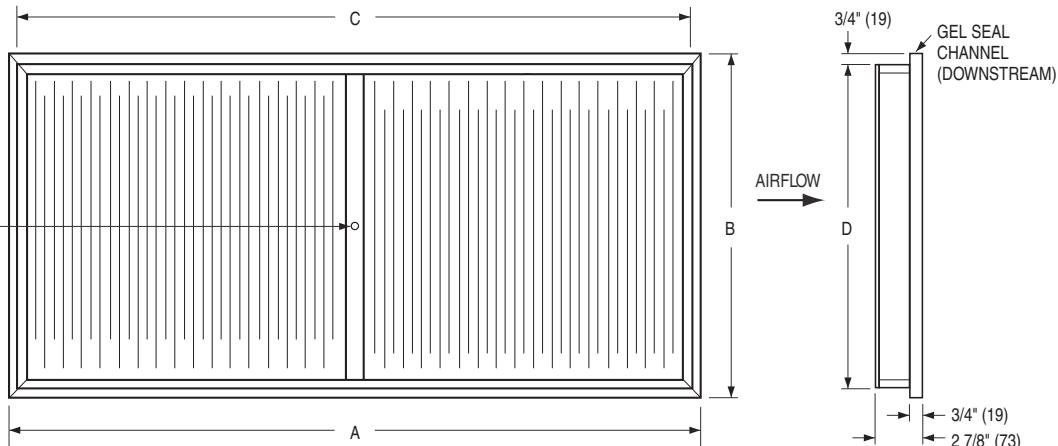

**DIMENSIONAL DATA**

Ceiling Module/ Nominal Diffuser/ Filter Size	A x B	C x D	Net Media Face Area Sq. ft. (m <sup>2</sup> )	Recommended Maximum Airflow cfm (l/s)	Maximum Airflow cfm (l/s)
48 x 12 (1219 x 305)	43 1/2 x 7 1/2 (1105 x 191)	42 x 6 (1067 x 152)	1.93 (0.179)	193 (91)	290 (137)
60 x 12 (1524 x 305)	55 1/2 x 7 1/2 (1410 x 191)	54 x 6 (1372 x 152)	2.50 (0.232)	250 (118)	375 (177)
24 x 24 (610 x 610)	19 1/2 x 19 1/2 (495 x 495)	18 x 18 (457 x 457)	1.96 (0.182)	196 (92)	294 (139)
36 x 24 (914 x 610)	31 1/2 x 19 1/2 (800 x 495)	30 x 18 (762 x 457)	3.37 (0.313)	337 (159)	506 (239)
48 x 24 (1219 x 610)	43 1/2 x 19 1/2 (1105 x 495)	42 x 18 (1067 x 457)	4.77 (0.443)	477 (225)	716 (338)
60 x 24 (1524 x 610)	55 1/2 x 19 1/2 (1410 x 495)	54 x 18 (1372 x 457)	6.17 (0.573)	617 (291)	926 (437)

**PRESSURE DROP VALUES (in. w.g.) FOR UNUSED FILTER**

Face Velocity (Net Media)	FPM	50	70	90	100	110	130	150
48 x 12 (1219 x 305)	CFM Δ Ps	97 0.29	135 0.39	174 0.49	193 0.54	212 0.59	251 0.69	290 0.79
60 x 12 (1524 x 305)	CFM Δ Ps	125 0.29	175 0.39	225 0.49	250 0.54	275 0.59	325 0.69	375 0.79
24 x 24 (610 x 610)	CFM Δ Ps	98 0.29	137 0.39	176 0.49	196 0.54	216 0.59	255 0.69	294 0.79
36 x 24 (914 x 610)	CFM Δ Ps	169 0.29	236 0.39	303 0.49	337 0.54	371 0.59	438 0.69	506 0.79
48 x 24 (1219 x 610)	CFM Δ Ps	239 0.29	334 0.39	429 0.49	477 0.54	525 0.59	620 0.69	716 0.79
60 x 24 (1524 x 610)	CFM Δ Ps	309 0.29	432 0.39	555 0.49	617 0.54	679 0.59	802 0.69	926 0.79

**FILTER SPECIFICATIONS:**

- Nailor HEPA filters are designed specifically to fit Nailor 92LFDF-AL, 92LFDMF-AL, 92LFDHF-AL, 92LFDF-SS, 92RPDF-1SS and 92RPDF-2SS diffusers.
- Filter efficiency is 99.99% on 0.3 micron particles per standard: IEST-RP-CC001.5 (Institute of Environmental Science & Technology).
- The filter resistance to air flow will be a maximum of 0.54" w.g. (135 Pa.) at 100 fpm. (0.51 m/s). Refer to chart for addition pressure drop values.
- Filter is PAO scan tested for leaks at an air flow of 100 fpm (0.51 m/s).
- Frame material is extruded anodized aluminum.
- Filter has a downstream gel seal to mate with diffuser HEPA knife edge. Gel seal material is urethane (Blue).
- Filter media is a 2" (51) deep separatorless media pack.
- Filter is constructed of fire-rated material per standard UL-900.
- Filter has a centerboard with removable test port for filter pressure drop measurement, damper adjustment or leakage testing. Cadmium plated screw (included with filter).
- The filter maximum operating temperature is 160°F (71°C) and the maximum relative humidity (R.H.) is 100%.

**SCHEDULE TYPE:**

**PROJECT:**

**ENGINEER:**

**CONTRACTOR:**

Dimensions are in inches (mm).

DATE	B SERIES	SUPERSEDES	DRAWING NO.
10 - 20 - 15	9200	4 - 1 - 13	92HEPA