




**EZVAV DIGITAL CONTROLS
SERIES FAN POWERED (CAV) TERMINAL UNIT
COOLING (PLENUM HEAT ONLY)
PRESSURE INDEPENDENT
MODELS: 35S(ST) AND 37S(ST) N300**

IF CONTROLLERS ARE TO BE NETWORKED TOGETHER, TURN ON EOL DIP SWITCHES ON THE CONTROLLERS AT BOTH PHYSICAL ENDS OF THE NETWORK. CONNECT SHIELD TO EARTH GROUND AT ONLY ONE POINT.

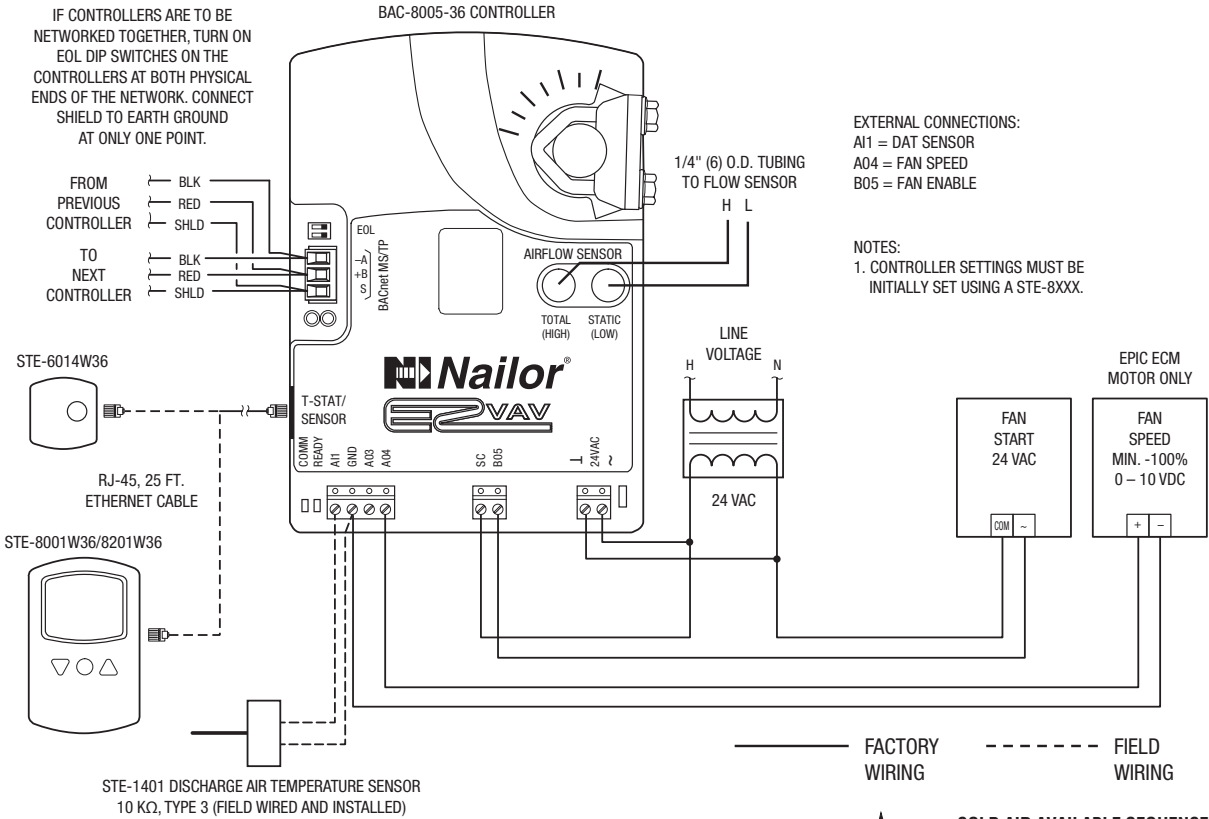

EXTERNAL CONNECTIONS:
A11 = DAT SENSOR
A04 = FAN SPEED
B05 = FAN ENABLE

NOTES:
1. CONTROLLER SETTINGS MUST BE INITIALLY SET USING A STE-8XXX.




Room Temperature Sensor Option:

- TSD Digital Display (STE-8001W36)
- TSDO Digital Display w/Occupancy Motion Sensor (STE-8201W36)
- TSR Rotary Dial (STE-6014W36)

CONTROL SEQUENCE N300

Sequence of Operation:

1. Changeover/Morning Warm-up (Central AHU Heat/Cool): If supply air as measured by the discharge air temperature (DAT) sensor is below 72°F (22.2°C), cool air is said to be available. If supply air is above 76°F (24.4°C), warm air is said to be available.
2. Cool Air Available: As space temperature rises above the cooling setpoint, the controller increases primary airflow. At a space temperature of 2°F (1.1°C) above the cooling setpoint, maximum cooling airflow is maintained. On a decrease in space temperature, the controller reduces airflow. Below cooling setpoint, minimum airflow is maintained.
3. The fan is started during occupied and standby modes and runs continuously at maximum fan speed. The fan induces warm ceiling plenum air as the primary airflow varies and maintains a constant volume to the space. During unoccupied mode, the fan starts on a call for heating only. The fan stops only during unoccupied mode when there is no call for heat. EPIC ECM Motor Only: During standby and unoccupied modes, the fan runs at minimum fan speed.
4. As the space temperature drops below the heating setpoint, the fan continues to recirculate warm ceiling plenum air.
5. Warm Air Available: As space temperature drops below the heating setpoint, the controller increases primary airflow. At a space temperature of 2°F (1.1°C) below the heating setpoint, maximum heating airflow is maintained. On an increase in space temperature, airflow decreases. As space temperature rises above the heating setpoint, minimum heating airflow is maintained.

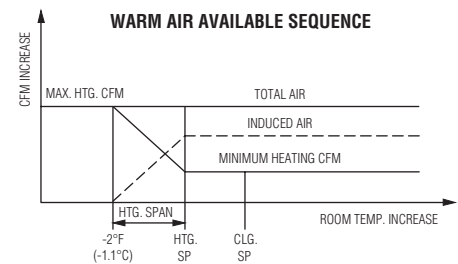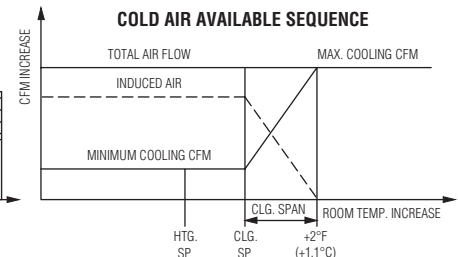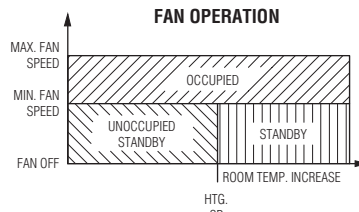

SCHEDULE TYPE:				
PROJECT:				
ENGINEER:				
CONTRACTOR:				
DATE	B SERIES	SUPERSEDES	DRAWING NO.	
2 - 22 - 23	3500	10 - 20 - 15	D35N300	