

CEILING RADIATION DAMPER

FOR WOOD TRUSS CEILING ASSEMBLIES INSULATED REGISTER BOX • SIDE INLET



MODEL: 0757-CB

QUALIFICATIONS:

- UL 263 CLASSIFIED CEILING RADIATION DAMPER. Category CABS. (File # R9660).
- 1 hour rated for use in UL floor/ceiling design numbers L528/L546/L550/L558/L562/L574/L576/L579/L581/L583/ L585/M501/M503 and roof/ceiling design numbers P531/ P533/P538/P545/P547/P552. (Other proprietary UL design numbers may be similar. Local approval by AHJ is required to use a Nailor design when not specified).
- Meets NFPA 90A requirements.

DESCRIPTION:

Ceiling dampers are designed to function as a heat barrier in air handling openings penetrating fire resistive membrane ceilings. The Model 0757-CB has been especially designed and tested to provide protection and simple installation in specific UL design wood truss ceiling assemblies.

The 0757-CB assembly consists of a rectangular ceiling damper recessed in a Type CB internally insulated sheet metal register box (boot) with a round 90° side inlet collar, that accommodates a steel grille or register.

STANDARD CONSTRUCTION:

Fusible Link: UL Listed, 212°F (100°C), std.
Blades: 22 ga. (0.85) roll-formed galv. steel.
Blade Insulation: Non-asbestos UL Classified.
Damper Frame: 22 ga. (0.85) galvanized steel.
Internal Insulation: 1 1/2" (38) R-6.3 value.

6. Plenum: Steel plenum: 28 ga. (0.47) min. with

round connection collar.

7. Duct: UL Classified Class 0 or 1 flexible air

duct connection by others.

8. Flange: Plaster flange.

9. Steel Grille/ By Nailor or others. Standard depth **Register:** for grille clearance is 2 1/2" (64).

OPTIONS:

- 1. **R8** 2" (51) thick R-8 value insulation.
- 2. Non-standard temperature U.L. Listed fusible link.

□ 165 165°F (74°C)

3. Installation Support Angles. 26" (660) long.

☐ ISA 2 @ 3/4" x 3/4" x 16 ga. (19 x 19 x 1.6) or

☐ ISB 2 @ 1 1/2" x 1 1/2" x 22 ga. (38 x 38 x 0.85)


4. Damper Style:


□ 0716 Butterfly (two blades) standard.

□ 0714 Single blade (out of airstream).

NOTE:

Building code and UL Classification require damper installation in accordance with manufacturer's instructions, see IOM-CRD0757INST.

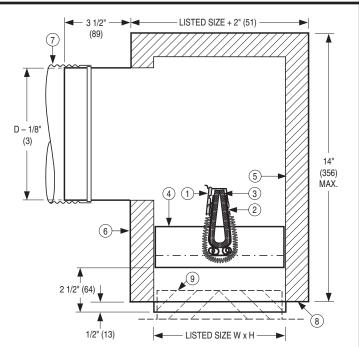



Dimensional Data (W x H):

| Available Sizes | | | | |
|-----------------------|--|--|--|--|
| WxH | Nominal Duct Size D | | | |
| 8" x 4" (203 x 102) | 4", 5" (102, 127) dia. | | | |
| 10" x 4" (254 x 102) | 4", 5", 6" (102, 127, 152) dia. | | | |
| 12" x 4" (305 x 102) | 6", 7", 8" (152, 178, 203) dia. | | | |
| 8" x 6" (203 x 152) | 6" (152) dia. | | | |
| 10" x 6" (254 x 152) | 5", 6", 7" (127, 152, 178) dia. | | | |
| 12" x 6" (305 x 152) | 6", 7", 8", 9" (152, 178, 203, 229) dia. | | | |
| 8" x 8" (203 x 203) | 5", 6" (127, 152) dia. | | | |
| 10" x 8" (254 x 203) | 7", 8" (178, 203) dia. | | | |
| 12" x 8" (305 x 203) | 7", 8" (178, 203) dia. | | | |
| 10" x 10" (254 x 254) | 7", 8" (178, 203) dia. | | | |
| 12" x 12" (305 x 305) | 8" (203) dia. | | | |
| | 9", 10" (229, 254) dia. | | | |

W x H = Nominal Grille/Register Size

| SCHEDULE TYPE: | Dimensione are in inches (mm) | | | |
|----------------|-------------------------------|----------|-------------|-------------|
| PROJECT: | Dimensions are in inches (mm) | | | |
| ENGINEER: | DATE | B SERIES | SUPERSEDES | DRAWING NO. |
| CONTRACTOR: | 9 - 16 - 21 | 0700 | 7 - 11 - 16 | 0757-CB |